



Guzek Associates, Inc.

*Mechanical, Electrical, Structural,
Environmental, and Architectural Engineering*

Phone: (570) 586-9700
Fax: (570) 586-6728
Email: guzekassoc@aol.com

401 DAVIS STREET
CLARKS SUMMIT, PA 18411-1837

August 22, 2019

Mr. Jeff Kelly
Assistant Director of Operations
Scranton School District
425 North Washington Avenue
Scranton, PA 18503

Reference: Asbestos Fiber Analysis
○ Northeast Intermediate School – **Background Testing**

Dear Mr. Kelly,

On August 20 and 21, 2019, Guzek Associates, Inc. (GAI) was on-site to perform asbestos air sampling by Transmission Electron Microscopy (TEM) method in the above-referenced location. This sampling was performed at the request of Mr. Kelly as a precautionary measure.

Guzek Associates performed asbestos air sampling utilizing a high volume vacuum pump attached to TEM cassettes. Samples were collected for two (2) hours at an airflow rate of 10.0 liters per minute (lpm). All asbestos TEM samples were delivered via Federal Express to an accredited laboratory for analysis with a 6-hour turnaround time.


The TEM test report is attached to this report. There were no asbestos fibers detected.

Analysis Methodologies:

All TEM air samples were collected and analyzed in accordance with all AHERA requirements. TEM analyses were performed by EMSL Analytical, Inc. located in Cinnaminson, NJ and were analyzed according to EPA 40 CFR Part 763 Final Rule (AHERA).

Should you have any questions on this report, please feel free to call me.

Very truly yours,



Brent M. Tripp

Attachments: FedEx Shipping Information (2 pages)
Chain-of-Custodies (3 pages)
TEM Results (2 pages)
Sampling Location Map (1 page)

Signature _____

NORTHEAST PACK AND SEND
215 S State Street
Clarks Summit, PA 18411
570-587-2272

Date: 08/20/19 Time: 16:03:41

FedEx
806056572072
Package ID: 26797

Workstation: Master Workstation

Northeast Pack & Send does not take responsibility for any loss or damages to pre-labeled drop off packages.
Thank you.
netitle.org
570-895-1000

Thank you for your business

FedEx Package Express
US Airbill

FedEx Tracking Number

8060 5657 2072

1 From Please print and press hard.

Date 8/20/19 Sender's FedEx Account Number 806056572072

Sender's Name Joseph Guzek Phone 570 586-9700

Company GUZEK ASSOCIATES INC

Address 401 DAVIS ST

Dept/Room/Suite/Room

City CLARKS SUMMIT State PA ZIP 18411-1837

2 Your Internal Billing Reference

First 24 characters will appear on invoice.

3 To Recipient's Name Sample Receiving Phone 800 220-3675

Company ENSL ANALYTICAL INC.

Address 200 ROUTE 130 NORTH

We cannot deliver to P.O. boxes or P.O. ZIP codes.

Address Use this line for the HOLD location address or for continuation of your shipping address.

City CINNMINSON State NJ ZIP 08077

0114703178

Sender's Copy

Packages up to 150 lbs.
For packages over 150 lbs., use the new
FedEx Express Freight US Airbill.

4 Express Package Service
NOTE: Service order has changed. Please select carefully.
* To meet location.

☒ FedEx First Overnight
Fastest service. Delivery by next business day, Monday through Saturday. Delivery is selected.

☐ FedEx Priority Overnight
Next business day delivery by 10:30 AM, Monday through Saturday. Delivery is selected.

☐ FedEx Standard Overnight
Next business day delivery by 3:00 PM, Monday through Saturday. Delivery is selected.

☐ FedEx 2Day
Delivery by Tuesday and Wednesday, Monday through Saturday. Delivery is selected.

☐ FedEx 2Day AM
Delivery by Tuesday and Wednesday, Monday through Saturday. Delivery is selected.

☐ FedEx Express Saver
Delivery by Thursday and Friday, Monday through Saturday. Delivery is selected.

☐ FedEx Express
Delivery by Friday, Monday through Saturday. Delivery is selected.

☐ FedEx
Delivery by Saturday, Monday through Saturday. Delivery is selected.

5 Packaging *Declared value limit \$500

☐ FedEx Envelope* ☐ FedEx Pak* ☒ FedEx Box ☐ Other

6 Special Handling and Delivery Signature Options

☐ SATURDAY Delivery
NOT available for FedEx Standard Overnight, FedEx 2Day AM, or FedEx Express Saver.

☐ No Signature Required
No signature required for delivery.

☐ Direct Signature
Signature required for delivery.

☐ Indirect Signature
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

☐ Signature Required
Signature required for delivery.

EMSL ANALYTICAL, INC.
LABORATORY PRODUCTS TRAINING

Asbestos Chain of Custody

EMSL Order Number (Lab Use Only):

0419 24647

EMSL Analytical, Inc.
200 Route 130 North

Cinnaminson, NJ 08077

PHONE: 1-800-220-3675

FAX: (856) 786-5974

Company Name: Guzek Associates, Inc		EMSL Customer ID:	
Street: 401 Davis Street		City: Clarks Summit	State/Province: PA
Zip/Postal Code: 18411	Country: US	Telephone #: 5705869700	Fax #: 570-586-6728
Report To (Name): Joseph Guzek		Please Provide Results: ☐ Fax ☒ Email	
Email Address: guzekassoc@aol.com		Purchase Order: 082019	
Project Name/Number: SSD.19704NE		EMSL Project ID (Internal Use Only):	
U.S. State Samples Taken: PA		CT Samples: ☐ Commercial/Taxable ☐ Residential/Tax Exempt	
EMSL-Bill to: ☐ Same ☐ Different - If Bill to is Different note Instructions in Comments**			
Third Party Billing requires written authorization from third party.			
Turnaround Time (TAT) Options* - Please Check			
☐ 3 Hour	☒ 6 Hour	☐ 24 Hour	☐ 48 Hour ☐ 72 Hour ☐ 96 Hour ☐ 1 Week ☐ 2 Week
*For TEM Air 3 hr through 6 hr, please call ahead to schedule. *There is a premium charge for 3 Hour TEM AHERA or EPA Level II TAT. You will be asked to sign an authorization form for this service. Analysis completed in accordance with EMSL's Terms and Conditions located in the Analytical Price Guide.			
PCM - Air ☐ Check if samples are from NY ☐ NIOSH 7400 ☐ w/ OSHA 8hr. TWA PLM - Bulk (reporting limit) ☐ PLM EPA 600/R-93/116 (<1%) ☐ PLM EPA NOB (<1%) Point Count ☐ 400 (<0.25%) ☐ 1000 (<0.1%) Point Count w/Gravimetric ☐ 400 (<0.25%) ☐ 1000 (<0.1%) ☐ NYS 198.1 (friable in NY) ☐ NYS 198.6 NOB (non-friable-NY) ☐ NYS 198.8 SOF-V ☐ NIOSH 9002 (<1%)		TEM - Air ☐ 4-4.5hr TAT (AHERA only) ☒ AHERA 40 CFR, Part ☐ 763 NIOSH 7402 ☐ EPA Level II ☐ ISO 10312 TEM - Bulk ☐ TEM EPA NOB ☐ NYS NOB 198.4 (non-friable-NY) ☐ Chatfield SOP ☐ TEM Mass Analysis-EPA 600 sec. 2.5 TEM - Water: EPA 100.2 Fibers >10µm ☐ Waste ☐ Drinking All Fiber Sizes ☐ Waste ☐ Drinking	
TEM - Dust ☐ Microvac - ASTM D 5755 ☐ Wipe - ASTM D6480 ☐ Carpet Sonication (EPA 600/J-93/167)		Soil/Rock/Vermiculite ☐ PLM EPA 600/R-93/116 with milling prep (<1%) ☐ PLM EPA 600/R-93/116 with milling prep (<0.25%) ☐ TEM EPA 600/R-93/116 with milling prep (<0.1%) ☐ TEM Qualitative via Filtration Prep ☐ TEM Qualitative via Drop Mount Prep ☐ Cincinnati Method EPA 600/R-04/004 - PLM/TEM (BC only) Other: ☐	
☐ Check For Positive Stop - Clearly Identify Homogenous Group		Filter Pore Size (Air Samples): ☐ 0.8µm ☐ 0.45µm	
Samplers Name: Brent M Tripp		Samplers Signature: Brent M. Tripp	
Sample #	Sample Description	Volume/Area (Air) HA # (Bulk)	Date/Time Sampled
101	Basement Carpet		2019 AUG 21 A 7:05
102	Basement - Storage Rm Pleurum #1		RECEIVED EMSL CINNAMINSON, NJ
103	Basement - Boiler Rm		
104	Ground Floor - Avel. Porium		
105	Ground Floor - Hallway outside Rm 03		
Client Sample # (s): One - FIVE		Total # of Samples: (5) FIVE	
Relinquished (Client): Brent M Tripp		Date: 8-20-19	Time: 4 pm
Received (Lab): DMB-to-xx		Date: 8-21-19	Time: 8A
Comments/Special Instructions:			

5



EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077
Tel/Fax: (800) 220-3675 / (856) 786-5974
<http://www.EMSL.com> / cinnaslab@EMSL.com

EMSL Order: 041924647

Customer ID: CLAG50

Customer PO: 082019

Project ID:

Attention: Joseph Guzek
Guzek Associates, Inc.
401 Davis Street
Clarks Summit, PA 18411

Phone: (570) 586-9700

Fax: (570) 586-6728

Received Date: 08/21/2019 08:00 AM

Analysis Date: 08/21/2019

Collected Date:

Project: SSD.19704NE

Test Report: Asbestos Fiber Analysis by Transmission Electron Microscopy (TEM) Performed by EPA 40 CFR Part 763 Appendix A to Subpart E

Sample	Location	Volume (Liters)	Area Analyzed (mm ²)	Non Asb	Asbestos Type(s)	#Structures		Analytical Sensitivity (S/cc)	Asbestos Concentration	
						≥0.5μ	< 5μ		(S/mm ²)	(S/cc)
101	Basement Cafeteria	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048
041924647-0001										
102	Basement - Storage Rm Plenum #1	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048
041924647-0002										
103	Basement - Boiler Rm	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048
041924647-0003										
104	Ground Floor - Auditorium	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048
041924647-0004										
105	Ground Floor - Hallway Outside Room 03	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048
041924647-0005										

Analyst(s)

Ted Young (5)


Benjamin Ellis, Laboratory Manager
or other approved signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported above and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. EMSL is not responsible for data reported in structures/cc, which is dependent on volume collected by non-laboratory personnel. Samples received in good condition unless otherwise noted. The test results meet the requirements of NELAC unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request.

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ NVLAP Lab Code 101048-0, AIHA-LAP, LLC-IHLAP Lab 100194, NYS ELAP 10872, NJ DEP 03036, PA ID# 68-00367, LA #04127

Initial report from: 08/21/2019 13:54 PM

ASB_TEMAHERA_0004_0001 Printed: 8/21/2019 1:54:31PM

Page 1 of 1

Signature _____

ORTHEAST PACK AND SEND
215 S State Street
Clarks Summit, PA 18411
570-587-2272

Date: 08/21/19 Time: 14:56:26

FedEx
806056572083
Package ID: 26815

Workstation: Master Workstation

Northeast Pack & Send does not take responsibility for any loss or damages to pre-labeled drop off packages.
Thank you.
netitle.org
570-895-1000

Thank you for your business

FedEx Package
Express **US Airbill**

FedEx
Tracking
Number

8060 5657 2083

1 From Please print and press hard.

Date 8/21/19 Sender's FedEx Account Number 1128-6976-0

Sender's Name Joseph Guzek Phone (570) 586-9700

Company GUZEK ASSOCIATES INC

Address 401 DAVIS ST

City CLARKS SUMMIT State PA ZIP 18411-1837

2 Your Internal Billing Reference
First 24 characters will appear on invoice.

3 To Recipient's Name Sample Receiving Phone 800 220-3675

Company ENSL ANALYTICAL INC.

Address 200 ROUTE 130 NORTH Dept./Floor/Suite/Room

Address CINNAMINSON State NJ ZIP 08077

0114703178

MUR1

Form
ID No. **0215**

4 Express Package Service *To most locations.
NO USE SERVICE WITH INTERNATIONAL DELIVERY. **Packages up to 150 lbs.**
Per package. See back for details. **FedEx Express Freight US Airtail.**

☒ **FedEx First Overnight**
Earliest next business morning delivery to select locations. Friday shipments will be delivered on Monday unless SATURDAY Delivery is selected.
☐ **FedEx Priority Overnight**
Next business morning. Friday shipments will be delivered on Monday unless SATURDAY Delivery is selected.
☐ **FedEx Standard Overnight**
Next business afternoon. Saturday Delivery NOT available.

5 Packaging *Declared value limit \$500.
☐ FedEx Envelope* ☐ FedEx Pak* ☒ FedEx Box ☐ FedEx Tube ☐ Other

6 Special Handling and Delivery Signature Options

☐ **SATURDAY Delivery**
Not available for FedEx Standard Overnight, FedEx 2Day A.M., or FedEx Express Saver.
☐ No Signature Required
Package may be left without obtaining a signature for delivery.
☐ Direct Signature
Someone at recipient's address may sign for delivery. Fee applies.
☐ Indirect Signature
If no one is available at recipient's address, someone at a neighboring address may sign for delivery. Fee applies. Residential deliveries only. Fee applies.

Does this shipment contain dangerous goods?
☐ No ☐ Yes ☐ Yes ☐ Yes ☐ Yes ☐ Yes
No per se. See back for details. ☐ Yes ☐ Yes ☐ Yes ☐ Yes ☐ Yes
Dry Ice ☐ Dry Ice ☐ Dry Ice ☐ Dry Ice ☐ Dry Ice
Dry Ice, 9, UN 1845 ☐ Dry Ice ☐ Dry Ice ☐ Dry Ice ☐ Dry Ice
Cargo Aircraft Only ☐ Cargo Aircraft Only ☐ Cargo Aircraft Only ☐ Cargo Aircraft Only ☐ Cargo Aircraft Only

7 Payment Bill to:
Sender ☐ Recipient ☐ Third Party ☐ Credit Card ☐ Cash/Check
FedEx Account No. Exp. Date

Total Packages Total Weight Total Declared Value*

Your liability is limited to \$500 unless you declare a higher value. See back for details. By using this Airbill you agree to the conditions on the back of this Airbill and in the current FedEx Service Guide, including terms and conditions of liability.

FedEx at your fingertips. Good call.
Scan to follow shipment instructions.

EMSL ANALYTICAL, INC.
LABORATORY PRODUCTS TRAINING

Asbestos Chain of Custody

EMSL Order Number (Lab Use Only):

041924794

Cinnaminson, NJ 08077

PHONE: 1-800-220-3675

FAX: (856) 786-5974

Company Name: Guzek Associates, Inc		EMSL Customer ID:	
Street: 401 Davis Street		City: Clarks Summit	State/Province: PA
Zip/Postal Code: 18411	Country: US	Telephone #: 5705869700	Fax #: 570-586-6728
Report To (Name): Joseph Guzek		Please Provide Results: ☐ Fax ☒ Email	
Email Address: guzekassoc@aol.com		Purchase Order: 082119	
Project Name/Number: SSD.19704NE		EMSL Project ID (Internal Use Only):	
U.S. State Samples Taken: PA		CT Samples: ☐ Commercial/Taxable ☐ Residential/Tax Exempt	
*EMSL-Bill to: ☐ Same ☐ Different - If Bill to is Different note Instructions in Comments** Third Party Billing requires written authorization from third party			
Turnaround Time (TAT) Options* - Please Check			
☐ 3 Hour ☒ 6 Hour ☐ 24 Hour ☐ 48 Hour ☐ 72 Hour ☐ 96 Hour ☐ 1 Week ☐ 2 Week			
*For TEM Air 3 hr through 6 hr, please call ahead to schedule. *There is a premium charge for 3 Hour TEM AHERA or EPA Level II TAT. You will be asked to sign an authorization form for this service. Analysis completed in accordance with EMSL's Terms and Conditions located in the Analytical Price Guide.			
PCM - Air ☐ Check if samples are from NY ☐ NIOSH 7400 ☐ w/ OSHA 8hr. TWA		TEM - Air ☐ 4-4.5hr TAT (AHERA only) ☒ AHERA 40 CFR, Part ☐ 763 NIOSH 7402 ☐ EPA Level II ☐ ISO 10312	
PLM - Bulk (reporting limit) ☐ PLM EPA 600/R-93/116 (<1%) ☐ PLM EPA NOB (<1%) Point Count ☐ 400 (<0.25%) ☐ 1000 (<0.1%) Point Count w/Gravimetric ☐ 400 (<0.25%) ☐ 1000 (<0.1%) ☐ NYS 198.1 (friable in NY) ☐ NYS 198.6 NOB (non-friable-NY) ☐ NYS 198.8 SOF-V ☐ NIOSH 9002 (<1%)		TEM - Bulk ☐ TEM EPA NOB ☐ NYS NOB 198.4 (non-friable-NY) ☐ Chatfield SOP ☐ TEM Mass Analysis-EPA 600 sec. 2.5 TEM - Water: EPA 100.2 Fibers >10µm ☐ Waste ☐ Drinking All Fiber Sizes ☐ Waste ☐ Drinking	
☐ Microvac - ASTM D 5755 ☐ Wipe - ASTM D6480 ☐ Carpet Sonication (EPA 600/J-93/167)		Soil/Rock/Vermiculite ☐ PLM EPA 600/R-93/116 with milling prep (<0.25%) ☐ PLM EPA 600/R-93/116 with milling prep (<0.25%) ☐ TEM EPA 600/R-93/116 with milling prep (<0.25%) ☐ TEM Qualitative via Filtration Prep ☐ TEM Qualitative via Drop Mount Prep ☐ Cincinnati Method EPA 600/R-04/004 - PLM/TEM (BC only) Other:	
☐ Check For Positive Stop - Clearly Identify Homogenous Group		Filter Pore Size (Air Samples): ☐ 0.8µm ☐ 0.45µm	
Samplers Name: Brent M Tripp		Samplers Signature: Brent M Tripp	
Sample #	Sample Description	Volume/Area (Air) HA # (Bulk)	Date/Time Sampled
Gr-1	Ground Floor Corridor "B"	1200	8/21/19 11:30 AM
1-1	1ST FLOOR, Corridor "A" near main d/t	1200	11:00 AM
1-2	1ST FLOOR, Corridor "B" near room 113	1200	11:08 AM
1-3	1ST FLOOR, Corridor "C" near room 105	1200	11:00 AM
2-1	2ND FLOOR, Corridor "A" near room 231	1200	11:13 AM
Client Sample # (s):		Total # of Samples:	
Relinquished (Client): Brent Tripp		Date: 8-21-19	Time: 2:00 PM
Received (Lab): OMB fo fx		Date: 8-22-19	Time: 8A
Comments/Special Instructions:			

10

EMSL ANALYTICAL, INC.
LABORATORY • PRODUCTS • TRAINING

Asbestos Chain of Custody

EMSL Order Number (Lab Use Only):

041924794

EMSL Analytical, Inc.

200 Route 130 North

Cinnaminson, NJ 08077

PHONE: 1-800-220-3675

FAX: (856) 786-5974

Additional Pages of the Chain of Custody are only necessary if needed for additional sample information

[illegible]

**EMSL Analytical, Inc.**

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

http://www.EMSL.com / cinnasblab@EMSL.com

EMSL Order: 041924794

Customer ID: CLAG50

Customer PO: 082119

Project ID:

Attention: Joseph Guzek
 Guzek Associates, Inc.
 401 Davis Street
 Clarks Summit, PA 18411


Phone: (570) 586-9700**Fax:** (570) 586-6728**Received Date:** 08/22/2019 08:00 AM**Analysis Date:** 08/22/2019**Collected Date:** 08/21/2019**Project:** SSD.19704NE

**Test Report: Asbestos Fiber Analysis by Transmission Electron Microscopy (TEM) Performed by
 EPA 40 CFR Part 763 Appendix A to Subpart E**

Sample	Location	Volume (Liters)	Area Analyzed (mm ²)	Non Asb	Asbestos Type(s)	#Structures ≥0.5μ < 5μ	≥5μ	Analytical Sensitivity (S/cc)	Asbestos Concentration (S/mm ²)	(S/cc)
G-1 041924794-0001	Ground Floor, Corridor B	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048
1-1 041924794-0002	1st Floor, Corridor A near Main Office	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048
1-2 041924794-0003	1st Floor, Corridor B near Room 113	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048
1-3 041924794-0004	1st Floor, Corridor C near Room 105	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048
2-1 041924794-0005	2nd Floor, Corridor A near Room 231	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048
2-2 041924794-0006	2nd Floor, Corridor B near Room 217	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048
2-3 041924794-0007	2nd Floor, Corridor C near Room 205	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048
3-1 041924794-0008	3rd Floor, Corridor A near Room 335	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048
3-2 041924794-0009	3rd Floor, Corridor B near Room 316	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048
3-3 041924794-0010	3rd Floor, Corridor C near Room 304	1200.00	0.0665	0	None Detected	0	0	0.0048	<15.00	<0.0048

Analyst(s)

Ted Young (10)


 Benjamin Ellis, Laboratory Manager
 or other approved signatory






EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported above and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. EMSL is not responsible for data reported in structures/cc, which is dependent on volume collected by non-laboratory personnel. Samples received in good condition unless otherwise noted. The test results meet the requirements of NELAC unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request.

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ NVLAP Lab Code 101048-0, AIHA-LAP, LLC-IHLAP Lab 100194, NYS ELAP 10872, NJ DEP 03036, PA ID# 68-00367, LA #04127

Initial report from: 08/22/2019 13:03 PM

ASB_TEMAHHERA_0004_0001 Printed: 8/22/2019 1:03:05PM

Page 1 of 1

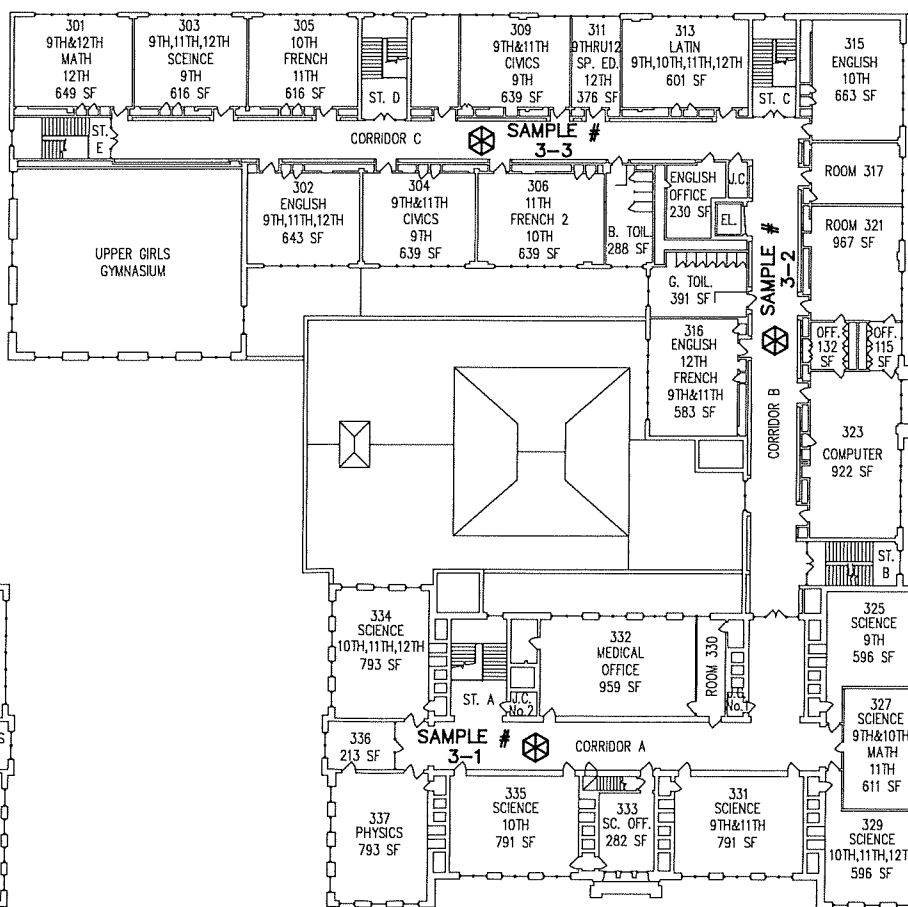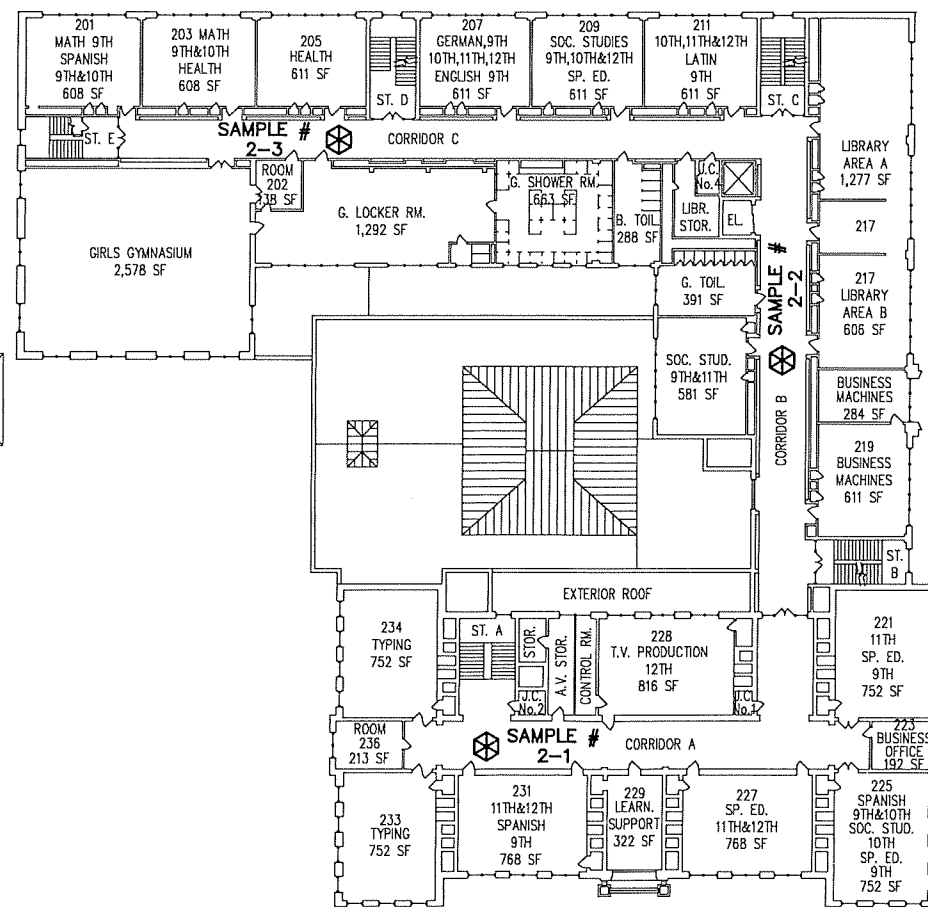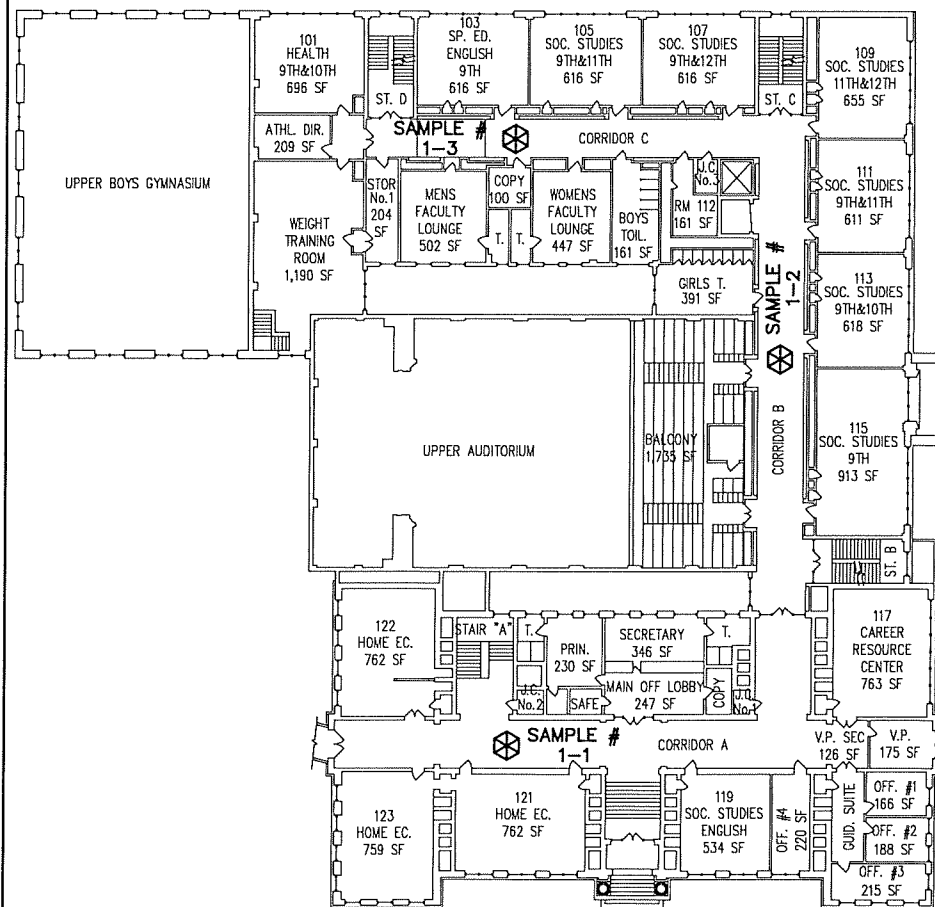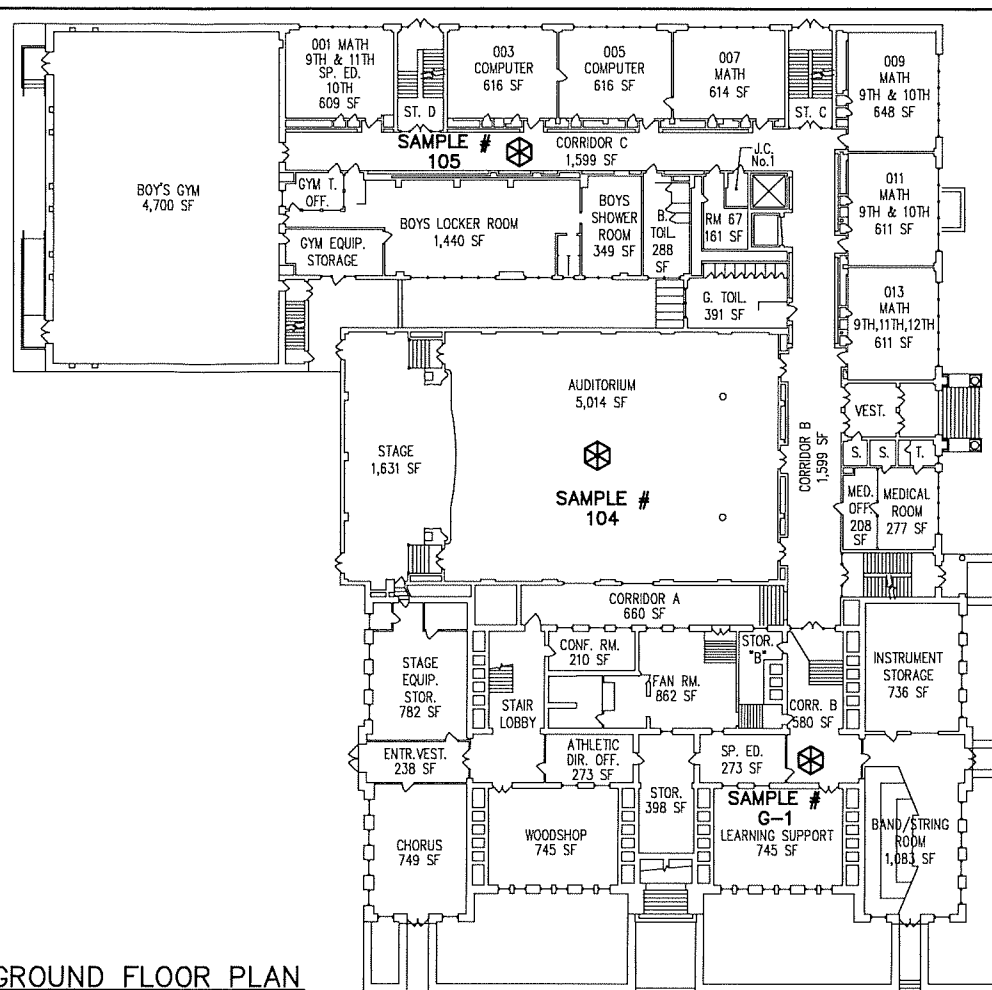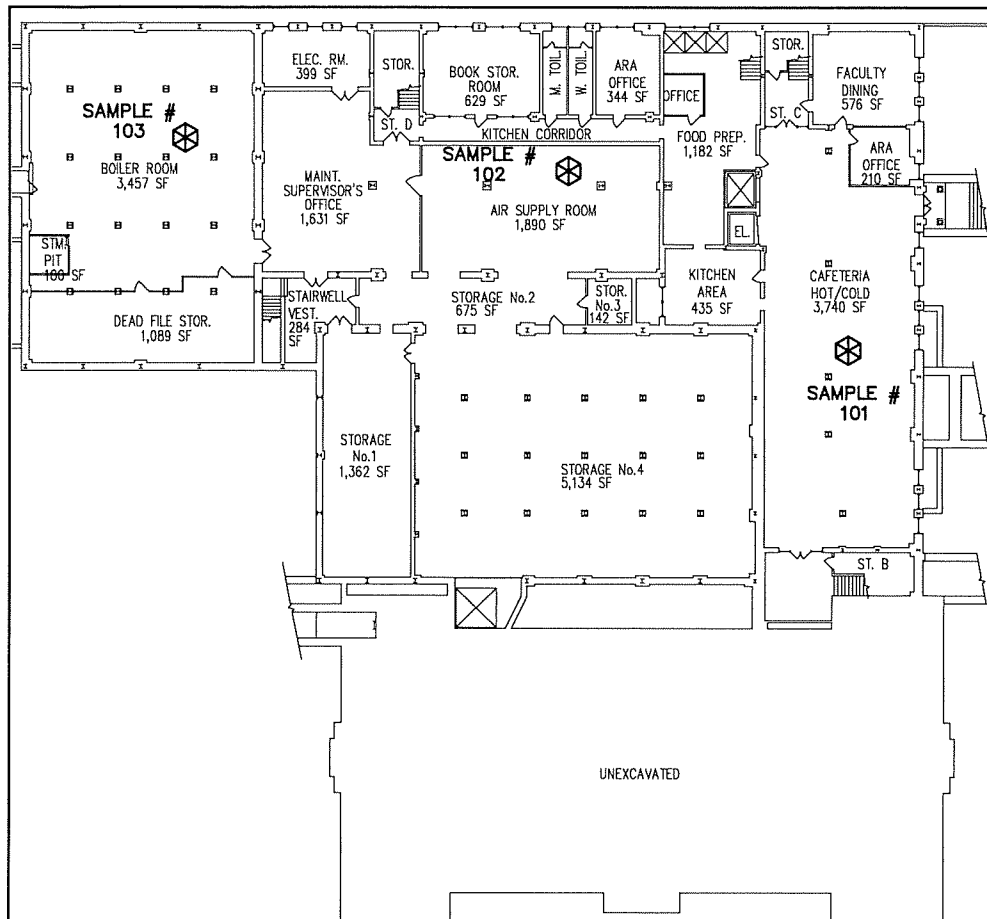

DRAWING No.:
SK
1